

Certificate

Certified Passive House component

for cool, temperate climate, valid until 31.12.2016

Category: Inclined Curtain Wall

Manufacturer: SCHÜCO International KG

33609 Bielefeld, GERMANY

Product name: AOC 50 TI.SI

The following comfort criteria were used in awarding this certificate:

Given a Ug value of 0,73 W/(m²K) and an element size of 1.23 m by 2.50 m,

 $U_{CWi} = 0.83 \text{ W/(m}^2\text{K}) \le 1.00 \text{ W/(m}^2\text{K})$

Taking into account the installation based thermal bridges, and provided that the installation is, with regard to the thermal bridges, equal or better than shown in the data sheet, the facede meets the following criterion.

 $U_{CWi,installed} \leq 1.00 \text{ W/(m}^2\text{K)}$


Thermal data of the construction

	U _f -value [W/(m ² K)]	Width [mm]	Ψ _g [W/(mK)]	f _{Rsi=0,25}
Spacer			SwisspacerV*	
Transom (t)	0,98	50	0,035	0.74
Mullion (m)	0,98	50	0,035	0,74
Thermal glass carrier bridge χ _{GT} [W/K]:				0,004

*Spacers of lower thermal quality, especially those made of aluminium, lead to significantly higher thermal losses and lower temperature factors.

Further information see data sheet

Passive House Institute Dr. Wolfgang Feist 64283 Darmstadt GERMANY



phA

advanced component

phB basic component

phC certifiable component

not suitable for Passive Houses






Data Sheet SCHÜCO International KG, AOC 50 TI.SI

Manufacturer SCHÜCO International KG

33609 Bielefeld, GERMANY

Tel.: +49 521 783 0 www.schueco.com

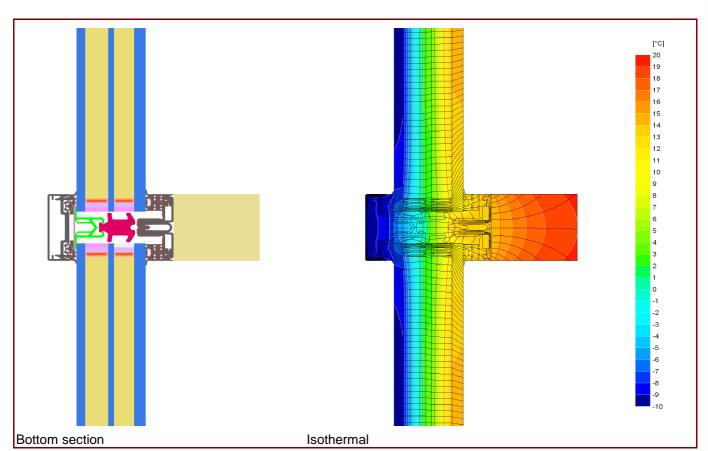

Description

Timber construction, with aluminium system carrier. Covering- and pressure-strip from aluminium. PE-foam insulator in the glazing rebate (0,040 W/(mK)). Used Pane: 48 mm (6/16/4/14/8), intersection of the Glass: 13 mm. Used spacer: SwisspacerV

Thermal data

	U _f -value	Width	Ψ_{g}	f _{Rsi=0.25}
	$[W/(m^2K)]$	[mm]	[W/(mK)]	[-]
Spacer			Swiss	spacerV*
Transom (t)	0,98	50	0,035	0,74
Mullion (m)	0,98	50	0,035	0,74
Opening element				
-				
Thermal glass carrier bridge χ _{GT} [W/K]:			0,004	

^{1:} Includes $\Delta U = 0.18 \text{ W/(m}^2\text{K})$, measured by ift Rosenheim


^{2:} Measured by ift Rosenheim

^{*} Spacers of lower thermal quality leading to higher thermal losses and lower temperatures.



Data Sheet SCHÜCO International KG, AOC 50 TI.SI

Installation

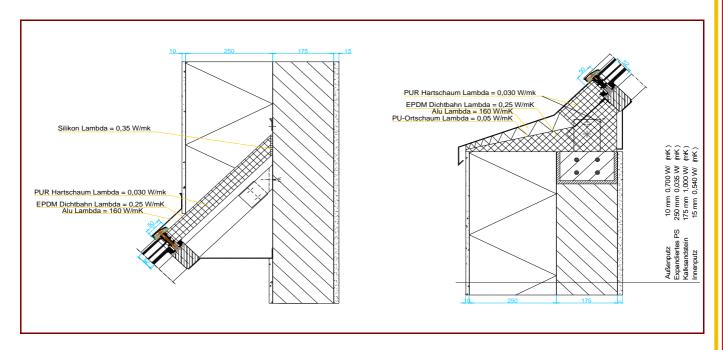

Installation based thermal bridge $\Psi_{\mbox{\tiny instal.}}$ in Passive House suitable walls

Position		EIFS	Timber construction wall	Ventilated facing
Bottom	[W/(mK)]	0,082		
Side/top	[W/(mK)]	0,082		
U _{CW,instaled}	[W/(m ² K)]	0,93		

Explanatory notes

The facade-U-values were calculated based on a 1.20 m by 2.50 m element $U_g = 0.73$ W/(m²K). If better glazing is used, the facade-U-value decrease as follow:

U Glazing	$\mathbf{U_g}$ [W/(m ² K)]	0,80	0,90
U Facade	U_{CW} [W/(m ² K)]	0,89	0,99

Depending on the thermal losses through opaque elements, transparent components are categorised according to efficiency classes. These thermal losses include the losses through the frame, multiplied by its width, the thermal bridge at the edge bond as well as the length of the edge bond.

Please ask the manufacturer for a detailed report containing all calculations and results.

For further information, please visit www.passivehouse.com or www.passipedia.org.