

# Certificate

## Certified Passive House component

for cool, temperate climate, valid until 31.12.2016

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
GERMANY

Category: **Curtain Wall**  
Manufacturer: **Kawneer, Alcoa Aluminium Inc.**  
Product name: **58642 Iserlohn, GERMANY**  
**Fassade AA100 HI**

The following comfort criteria were used in awarding this certificate:

Given a  $U_g$  value of  $0,70 \text{ W}/(\text{m}^2\text{K})$  and an element size of  $1.20 \text{ m}$  by  $2.50 \text{ m}$ ,

$$U_{CW} = 0,80 \text{ W}/(\text{m}^2\text{K}) \leq 0,80 \text{ W}/(\text{m}^2\text{K})$$

Taking into account the installation based thermal bridges, and provided that the installation is, with regard to the thermal bridges, equal or better than shown in the data sheet, the facade meets the following criterion.


$$U_{CW, \text{installed}} \leq 0.85 \text{ W}/(\text{m}^2\text{K})$$

### Thermal data of the construction


	$U_f$ -value [W/(m <sup>2</sup> K)]	Width [mm]	$\Psi_g$ [W/(mK)]	$f_{Rsi=0,25}$ [-]
Spacer	Swisspacer*			0,80
Transom (t)	0,81	50	0,037	
Mullion (m)	0,81	50	0,037	
Thermal glass carrier bridge $\chi_{GT}$ [W/K]:				0,004

\*Spacers of lower thermal quality, especially those made of aluminium, lead to significantly higher thermal losses and lower temperature factors.

Further information see data sheet

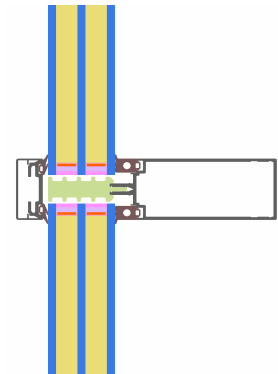

### Passive House Efficiency Class

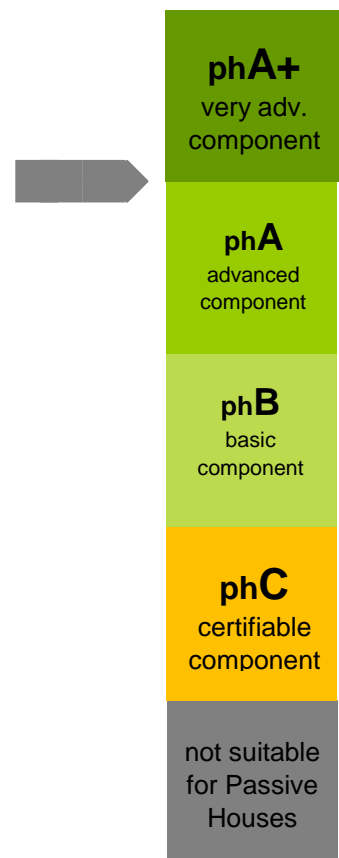


**CERTIFIED COMPONENT**

Passive House Institute

# Data Sheet Kawneer,Alcoa Aluminium Inc., Fassade AA100 HI

**Manufacturer** Kawneer,Alcoa Aluminium Inc.  
58642 Iserlohn, GERMANY

[www.kawneer.de](http://www.kawneer.de)

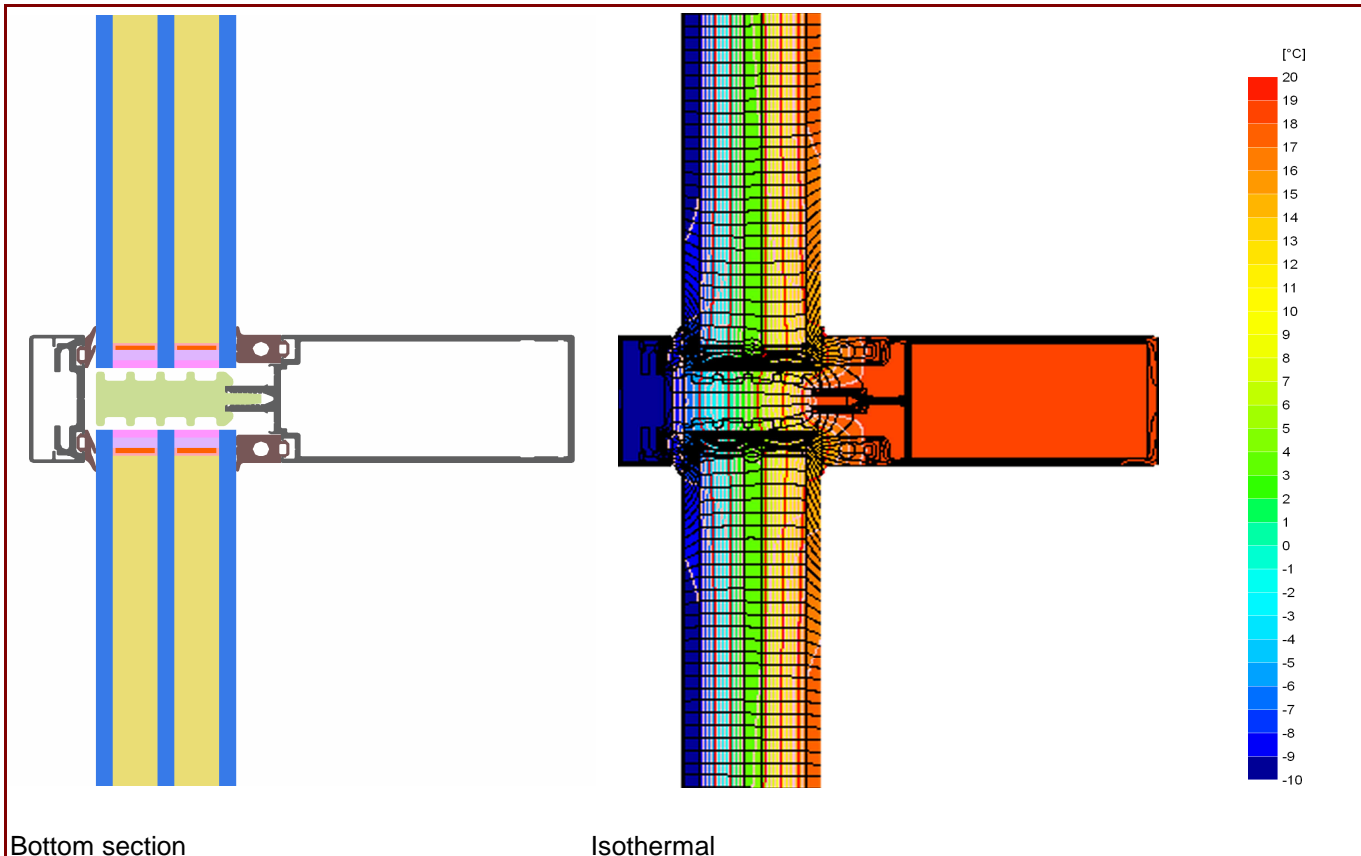


## Description

PVC Mullion and Transom, reinforced by internal steel beam. Outer devices form aluminium. Insulated b PE-foam (0,038 W/(mK)). Used Pane: 50 mm (6/16/6/16/6), intersection of the Glass: 13 mm. Used spacer: Swissspacer

## Thermal data


	$U_f$ -value <sup>1</sup> [W/(m²K)]	Width [mm]	$\Psi_g$ [W/(mK)]	$f_{Rsi=0.25}$ [-]
Spacer	Swissspacer*			
Transom (t)	0,81	50	0,037	0,80
Mullion (m)	0,81	50	0,037	
Opening element	1,30	180	0,031	0,75
-				
Thermal glass carrier bridge $\chi_{GT}$ [W/K]:				0,0040
1: Includes $\Delta U = 0,15$ W/(m²K), simulated by PHI				
2: Simulated by PHI				

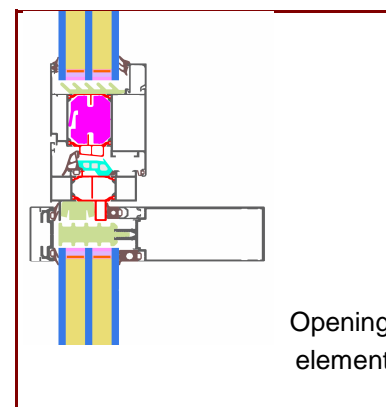

\* Spacers of lower thermal quality leading to higher thermal losses and lower temperatures.

# Data Sheet Kawneer,Alcoa Aluminium Inc., Fassade AA100 HI

## Installation

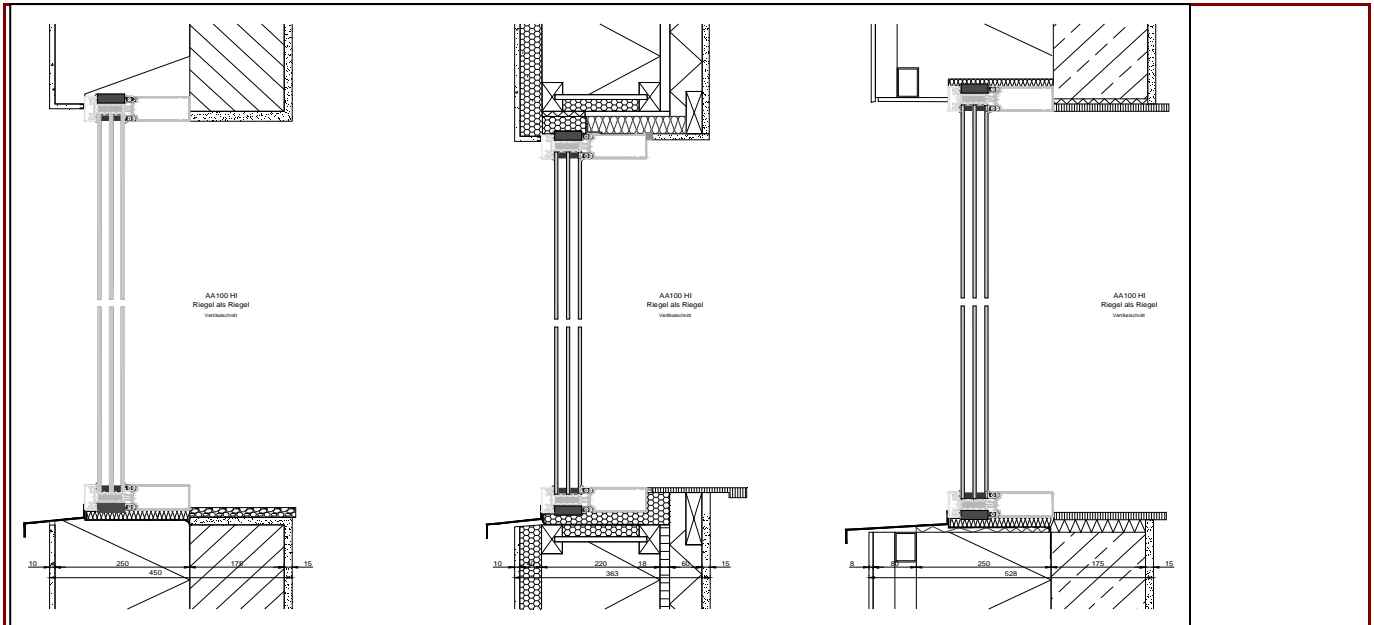

## Installation based thermal bridge $\Psi_{\text{instal.}}$ in Passive House suitable walls

		EIFS	Timber construction wall	Ventilated facing
<b>Position</b>				
<b>Bottom</b>	[W/(mK)]	0,039	0,043	0,040
<b>Side/top</b>	[W/(mK)]	0,028	0,044	0,031
<b><math>U_{\text{CW,instaled}}</math></b>	[W/(m <sup>2</sup> K)]	0,84	0,85	0,84

## Explanatory notes

The facade-U-values were calculated based on a 1.20 m by 2.50 m element  $U_g = 0.70 \text{ W/(m}^2\text{K)}$ .  
If better glazing is used, the facade-U-value decrease as follow:

<b>U Glazing</b>	<b><math>U_g</math> [W/(m<sup>2</sup>K)]</b>	0,66	0,60	0,57
<b>U Facade</b>	<b><math>U_{\text{CW}}</math> [W/(m<sup>2</sup>K)]</b>	0,76	0,70	0,67

Depending on the thermal losses through opaque elements, transparent components are categorised according to efficiency classes. These thermal losses include the losses through the frame, multiplied by its width, the thermal bridge at the edge bond as well as the length of the edge bond.

Please ask the manufacturer for a detailed report containing all calculations and results.

For further information, please visit [www.passivehouse.com](http://www.passivehouse.com) or [www.passipedia.org](http://www.passipedia.org).