

Certificate

Certified Passive House component

for cool, temperate climate, valid until 31.12.2016

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
GERMANY

Category: **Curtain Wall**
Manufacturer: **batimet GmbH**
01277 Dresden, GERMANY
Product name: **TM 50 SE**

The following comfort criteria were used in awarding this certificate:

Given a U_g value of $0,7 \text{ W}/(\text{m}^2\text{K})$ and an element size of 1.20 m by 2.50 m ,

$$U_{CW} = 0,80 \text{ W}/(\text{m}^2\text{K}) \leq 0.80 \text{ W}/(\text{m}^2\text{K})$$

Taking into account the installation based thermal bridges, and provided that the installation is, with regard to the thermal bridges, equal or better than shown in the data sheet, the facade meets the following criterion.


$$U_{CW, \text{eingebaut}} \leq 0.85 \text{ W}/(\text{m}^2\text{K})$$

Thermal data of the construction


	U_f -value [W/(m ² K)]	Width [mm]	Ψ_g [W/(mK)]	$f_{Rsi=0,2}$ [-]
Spacer	Swisspacer V*			0.78
Transom (t)	0.99	50	0.035	
Mullion (m)	0.92	50	0.035	
Thermal glass carrier bridge χ_{GT} [W/K]:				0.004

*Spacers of lower thermal quality, especially those made of aluminium, lead to significantly higher thermal losses and lower temperature factors.

Further information see data sheet

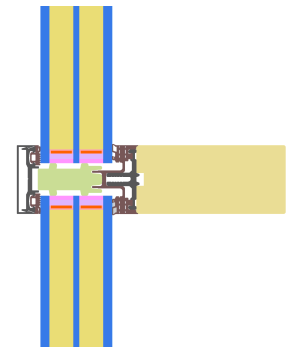

Passive House Efficiency Class

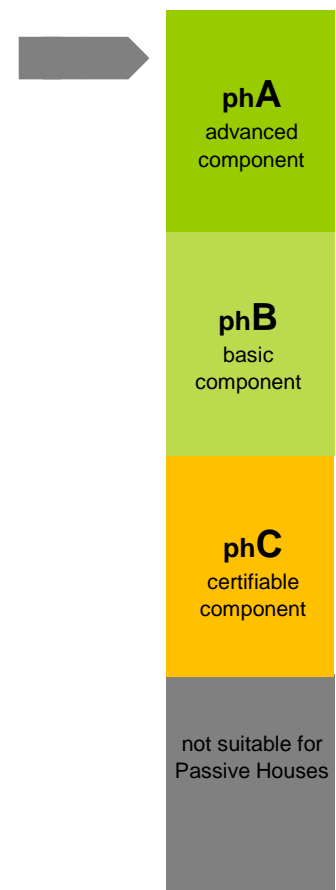


CERTIFIED COMPONENT

Passive House Institute

Data Sheet batimet GmbH, TM 50 SE

Manufacturer batimet GmbH
 Enderstrasse 90, 01277 Dresden, GERMANY
 Tel.: +49 (0) 351 811860
 www.batimet.de

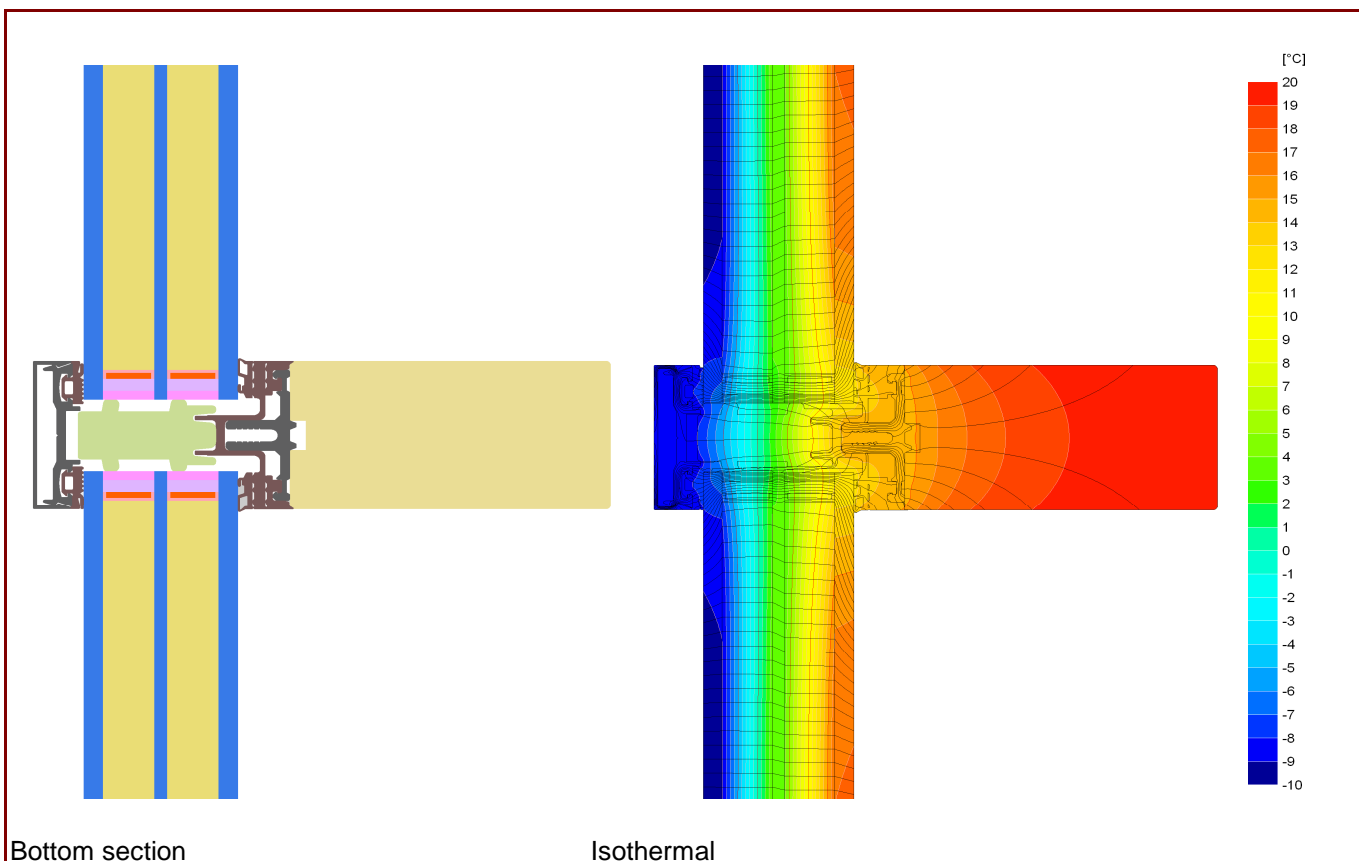

Description

Timber construction, Aluminium covering- and pressure-strip. PE-foam insulator in the glazing rebate (0,035 W/(mK)). Plastic glass-carrier on stainless steel screws. Used Pane: 48 mm (6/16/4/16/6), intersection of the Glass: 13 mm. Used spacer: Swisspacer V

Thermal data

	U _f -value [W/(m²K)]	Width [mm]	Ψ _g [W/(mK)]	f _{Rsi=0.20} [-]
Spacer	Swisspacer V*			0.78
Transom (t)	0.99	50	0.035	
Mullion (m)	0.92	50	0.035	
Opening element				
-				
Thermal glass carrier bridge χ _{GT} [W/K]:				0.004
1: Includes ΔU = 0,23 W/(m²K), Determined by 3D thermal flux simul. (PHI)				
2: Standard value according to the PHI criteria for transparent components				

Depending on the thermal losses through opaque elements, windows are categorised in to efficiency classes. These thermal losses include the losses through the frame, multiplied by its width, the thermal bridge at the edge bond as well as the length of the edge bond. Please ask the manufacturer for a detailed report.

* Spacers of lower thermal quality leading to higher thermal losses and lower temperatures.