

# Certificate

## Certified Passive House component

for cool, temperate climate, valid until 31.12.2016

Passive House Institute  
Dr. Wolfgang Feist  
64283 Darmstadt  
GERMANY

Category: **Curtain Wall**  
Manufacturer: **Jansen AG**  
**6463 Oberriet SG, SWITZERLAND**  
Product name: **VISS HI**

The following comfort criteria were used in awarding this certificate:

Given a  $U_g$  value of  $0,7 \text{ W/(m}^2\text{K)}$  and an element size of  $1.20 \text{ m}$  by  $2.50 \text{ m}$ ,

$$U_{CW} = 0,80 \text{ W/(m}^2\text{K)} \leq 0.80 \text{ W/(m}^2\text{K)}$$

Taking into account the installation based thermal bridges, and provided that the installation is, with regard to the thermal bridges, equal or better than shown in the data sheet, the facade meets the following criterion.


$$U_{CW, \text{eingebaut}} \leq 0.85 \text{ W/(m}^2\text{K)}$$

### Thermal data of the construction


	$U_f$ -value [W/(m <sup>2</sup> K)]	Width [mm]	$\Psi_g$ [W/(mK)]	$f_{Rsi=0,2}$ [-]
Spacer	Swisspacer V*			0,81
Transom (t)	0,92	50	0,037	
Mullion (m)	0,81	50	0,037	
Thermal glass carrier bridge $\chi_{GT}$ [W/K]:				0,008

\*Spacers of lower thermal quality, especially those made of aluminium, lead to significantly higher thermal losses and lower temperature factors.

Further information see data sheet

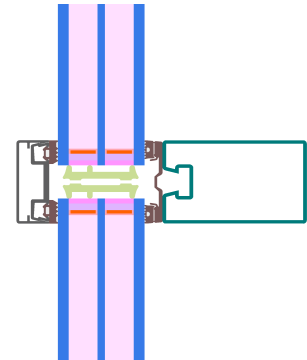

### Passive House Efficiency Class

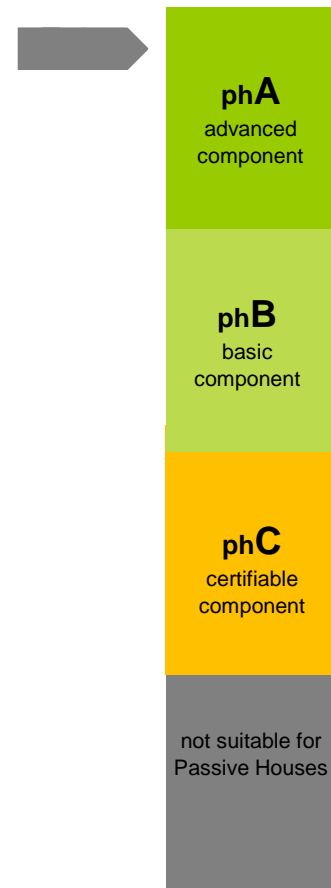


**CERTIFIED COMPONENT**

Passive House Institute

# Data Sheet Jansen AG, VISS HI

**Manufacturer** Jansen AG  
6463 Oberriet SG, SWITZERLAND  
Tel.: +41 71 763 9111  
www.jansen.com

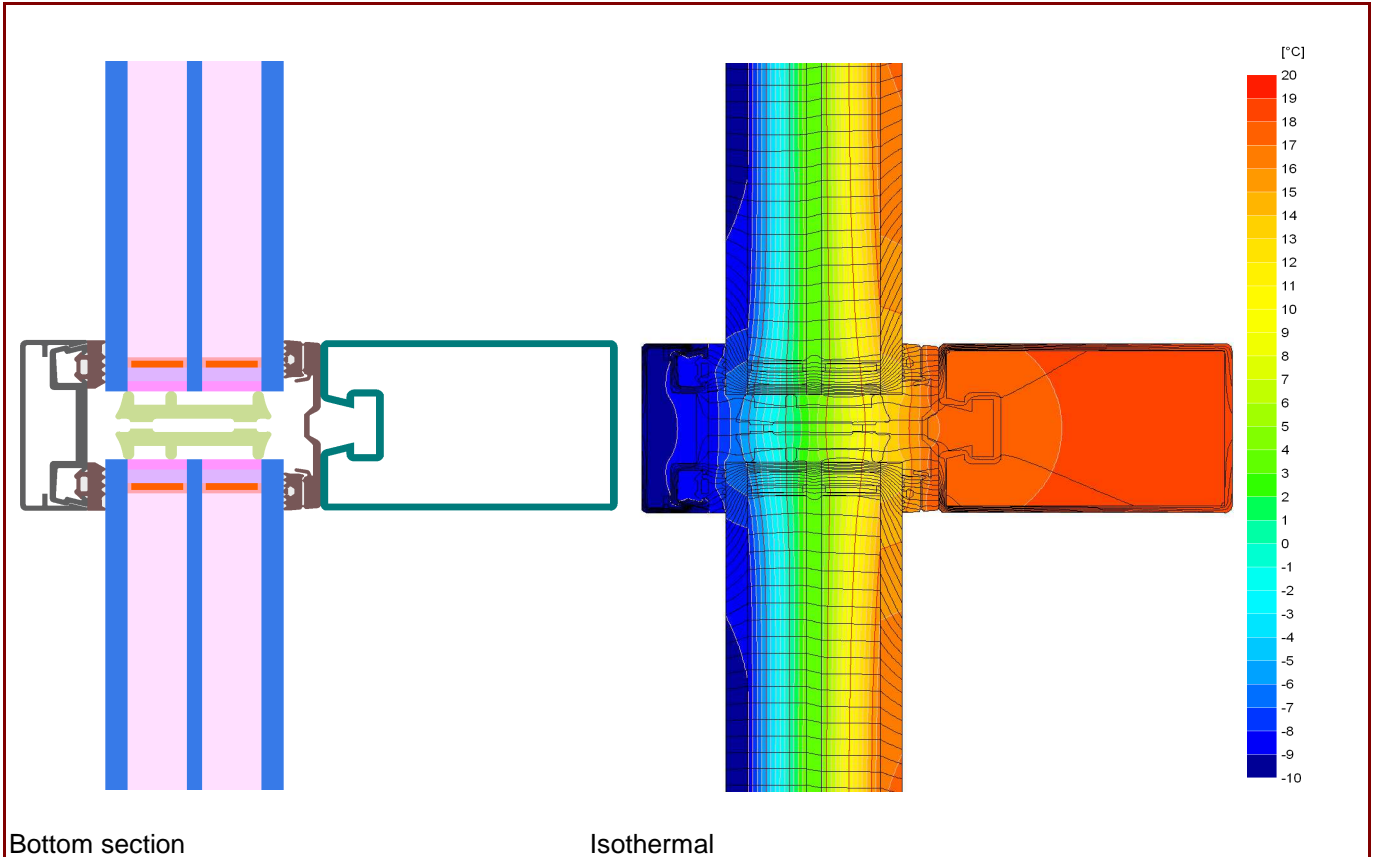

## Description

Steel construction, Aluminium covering- and pressure-strip. Covering-strip with reduced emissivity ( $\epsilon=0,1$ ) at the inside. PE-foam insulator in the glazing rebate ( $0,035 \text{ W}/(\text{m}^2\text{K})$ ). Plastic glass-carrier on stainless steel bolts. Thermally insulated screws. Used Pane: 48 mm (6/16/4/16/6), intersection of the Glass: 14 mm. Used spacer: Swisspacer V

## Thermal data

	<b>U<sub>f</sub>-value</b> [W/(m <sup>2</sup> K)]	<b>Width</b> [mm]	<b><math>\Psi_g</math></b> [W/(mK)]	<b>f<sub>Rsi=0.20</sub></b> [-]
Spacer	Swisspacer V*			0,81
Transom (t)	0,92	50	0,037	
Mullion (m)	0,81	50	0,037	
Opening element				
-				
Thermal glass carrier bridge $\chi_{GT}$ [W/K]:				0,008
1: Includes $\Delta U = 0,12 \text{ W}/(\text{m}^2\text{K})$ , Determined by 3D thermal flux simul. (PHI)				
2: Determined by 3D thermal flux simul. (PHI)				

Depending on the thermal losses through opaque elements, windows are categorised in to efficiency classes. These thermal losses include the losses through the frame, multiplied by its width, the thermal bridge at the edge bond as well as the length of the edge bond. Please ask the manufacturer for a detailed report.

\* Spacers of lower thermal quality leading to higher thermal losses and lower temperatures.