

Certificate

Certified Passive House component

for cool, temperate climate, valid until 31.12.2016

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
GERMANY

Category: **Curtain Wall**
Manufacturer: **MBJ Fassadentechnik GmbH**
87677 Stöttwangen, GERMANY
Product name: **System Holz - PH**

The following comfort criteria were used in awarding this certificate:

Given a U_g value of $0,7 \text{ W}/(\text{m}^2\text{K})$ and an element size of 1.20 m by 2.50 m ,

$$U_{CW} = 0,80 \text{ W}/(\text{m}^2\text{K}) \leq 0.80 \text{ W}/(\text{m}^2\text{K})$$

Taking into account the installation based thermal bridges, and provided that the installation is, with regard to the thermal bridges, equal or better than shown in the data sheet, the facade meets the following criterion.


$$U_{CW, \text{eingebaut}} \leq 0.85 \text{ W}/(\text{m}^2\text{K})$$

Thermal data of the construction


| | U_f -value [W/(m ² K)] | Width [mm] | Ψ_g [W/(mK)] | $f_{Rsi=0,2}$ [-] |
|---|--|---------------|----------------------|----------------------|
| Spacer | Swisspacer V* | | | 0,78 |
| Transom (t) | 0,97 | 50 | 0,034 | |
| Mullion (m) | 0,97 | 50 | 0,043 | |
| Thermal glass carrier bridge χ_{GT} [W/K]: | | | | 0,004 |

*Spacers of lower thermal quality, especially those made of aluminium, lead to significantly higher thermal losses and lower temperature factors.

Further information see data sheet

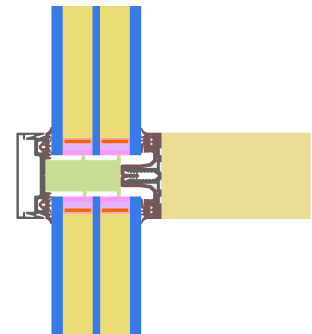

Passive House Efficiency Class

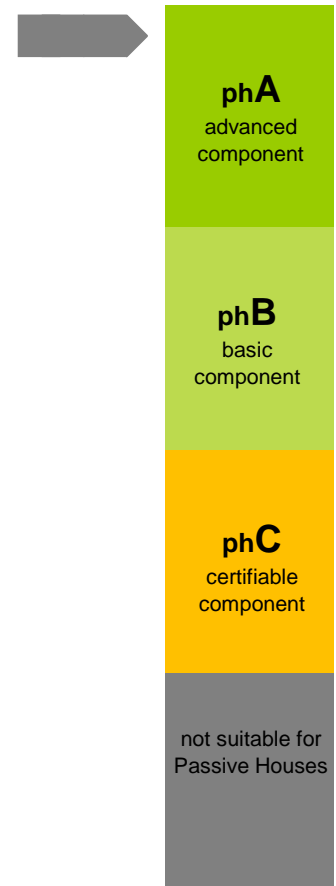


CERTIFIED COMPONENT

Passive House Institute

Data Sheet MBJ Fassadentechnik GmbH, System Holz - PH

Manufacturer MBJ Fassadentechnik GmbH
87677 Stöttwangen, GERMANY
Tel.: +49 (0) 8345 9528 0
www.mbj-fassadentechnik.de

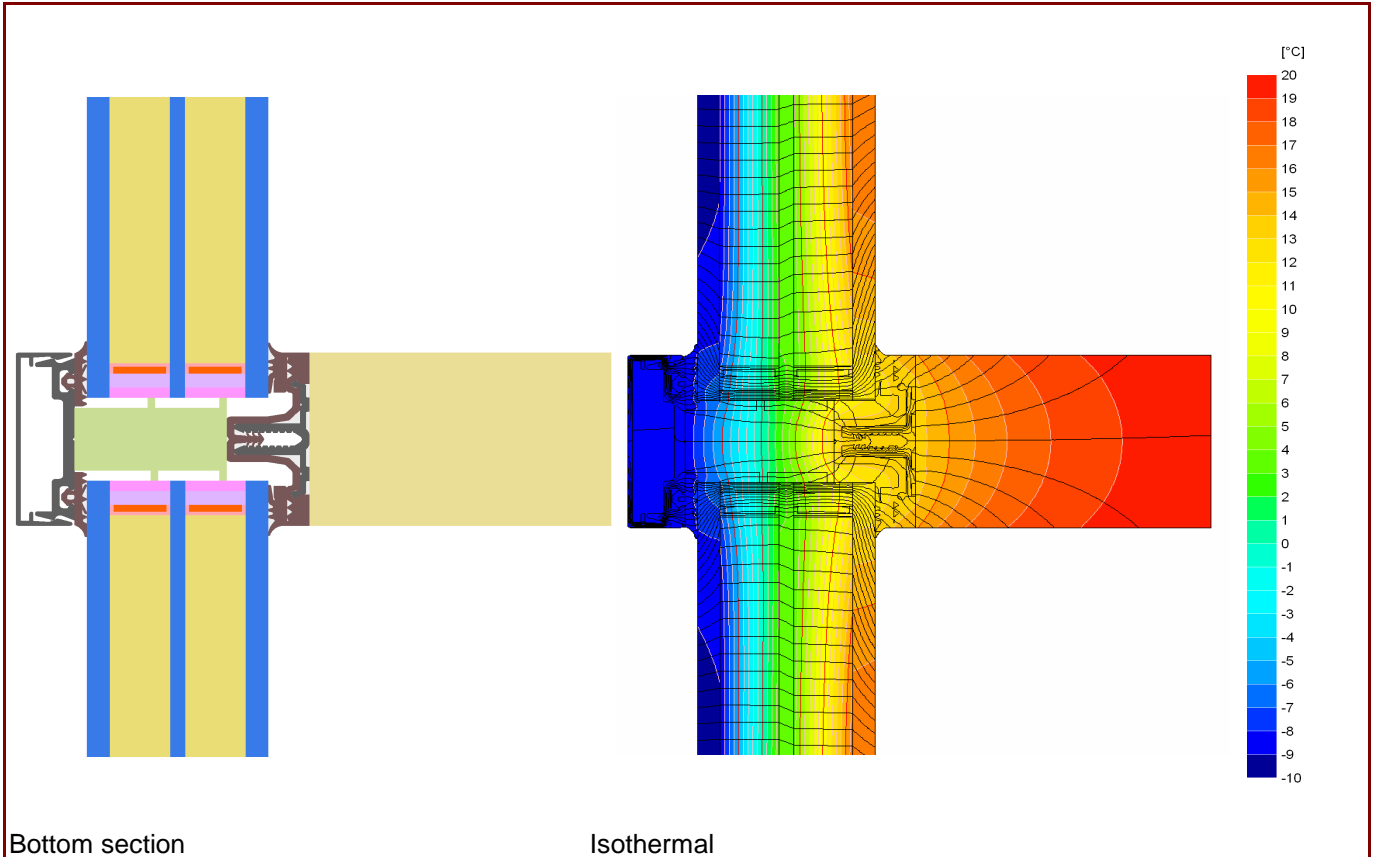

Description

Timber construction, Aluminium covering- and pressure-strip. PE-foam insulator in the glazing rebate. Plastic glass-carrier on stainless steel screws. Used Pane: 48 mm (6/16/4/16/6), intersection of the Glass: 13 mm. Used spacer: Swisspacer V

Thermal data

| | U_f -value [W/(m²K)] | Width [mm] | Ψ_g [W/(mK)] | $f_{Rsi=0.20}$ [-] |
|---|---------------------------|---------------|----------------------|-----------------------|
| Spacer | Swisspacer V* | | | |
| Transom (t) | 0,97 | 50 | 0,034 | 0,78 |
| Mullion (m) | 0,97 | 50 | 0,043 | |
| Opening element | | | | |
| - | | | | |
| Thermal glass carrier bridge χ_{GT} [W/K]: | | | | 0,004 |
| 1: Includes $\Delta U = 0,23$ W/(m²K), Determined by 3D thermal flux simul. (PHI) | | | | |
| 2: Standard value according to the PHI criteria for transparent components | | | | |

Depending on the thermal losses through opaque elements, windows are categorised in to efficiency classes. These thermal losses include the losses through the frame, multiplied by its width, the thermal bridge at the edge bond as well as the length of the edge bond. Please ask the manufacturer for a detailed report.

* Spacers of lower thermal quality leading to higher thermal losses and lower temperatures.